

Service letter

SL: 40034
Date: 14 June 2017
Product: Compressor generator option
Subject: Residual current device (RCD)

MODEL	SERIAL NUMBER

ESTIMATED INSTALLATION TIME: 0,5 HOURS*

*Approximate time only; actual time may vary.


GENERAL INFORMATION

Residual current device manufacturer has changed his product Art. No 2CSB202001R1630 type DDA202 AC $I_{\Delta n}$ 0,03A at the end of 2015.

Since that time new product is available with the same ABB Art. No. but it is no more usable for 110 V generators.

New product Art. No 2SCB202199R1630 is intended for use in 110V generator option only. CPN 46501896 rev. C See picture 1

Picture 1

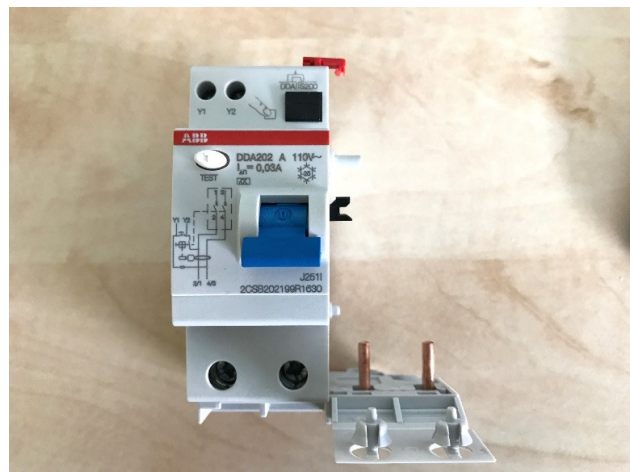

Suitability RCD identification

Old version 2CSB202001R1630 can still be used in 110V machines if marking on the side shows 230/400V~

See picture 2

Picture 2




Don't use

Art. No. 2CSB202001R1630 if marking on the side shows $U_n=230V$

$U_{T_min}=170V$

See picture 3

Picture 3

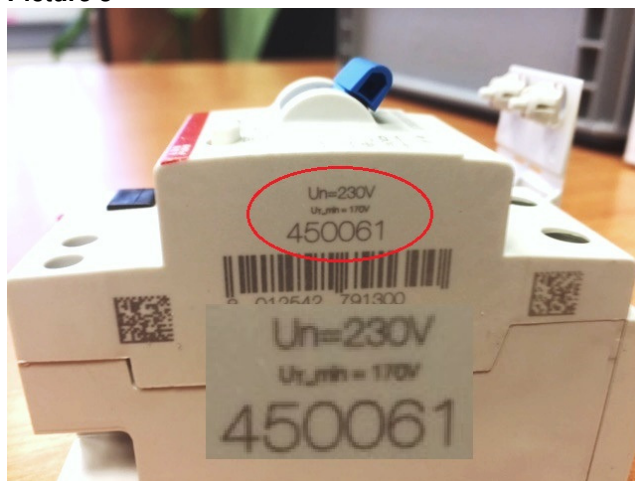

Check your stock items carefully for correct type. Inform your customers about correct type, when source part from local electric shop.